


FENCE


NOTES:

1. DEPTH OF FOOTINGS ARE INTO NATURAL UNDISTURBED SOIL OR TESTED OR APPROVED COMPACTED FILL.
2. CONCRETE FOOTINGS SHALL BE A MIN. FIVE SACK MIX. (2500 F. MIN. IN 28 DAYS).
3. THE FOLLOWING ITEMS SHALL BE FURNISHED & INSTALLED ONLY WHEN SHOWN ON PLANS AND/OR CALLED FOR IN THE SPECIAL PROVISIONS:
 - A. BARBED WIRE
 - B. EXTENTION ARM
 - C. TOP RAIL
 - D. VINYL SLATS
4. 9 GAUGE WIRE FASTENERS SHALL BE USED.
5. DETAIL 'A' REFERS TO ALL PUBLIC ENCLOSURES UNLESS SPECIFICALLY NOTED OTHERWISE.
6. WHEN FENCE IS AROUND A DRAINAGE BASIN A 6" x 8" CONCRETE CURB SHALL BE POURED UNDER FENCE, FLUSH WITH BOTTOM OF FENCE FABRIC.
7. WHERE SLATS ARE CALLED FOR ON PLANS, ALL LINE POSTS SHALL BE 2-3/8" O.D. SCH. 40 PIPE.

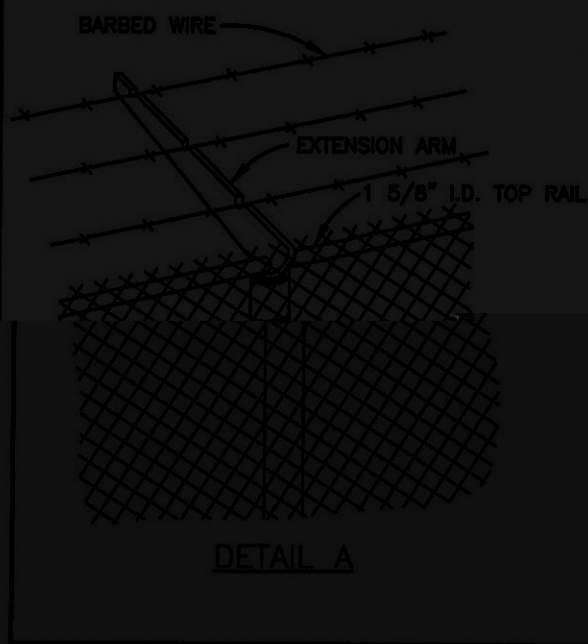

CITY of CORCORAN • Department of Public Works

Standard Drawing for:
CHAINLINK FENCE DETAILS

APPROVED:  City Engineer

05/19/ Date

Revised:

M-10