


RAISED CURB

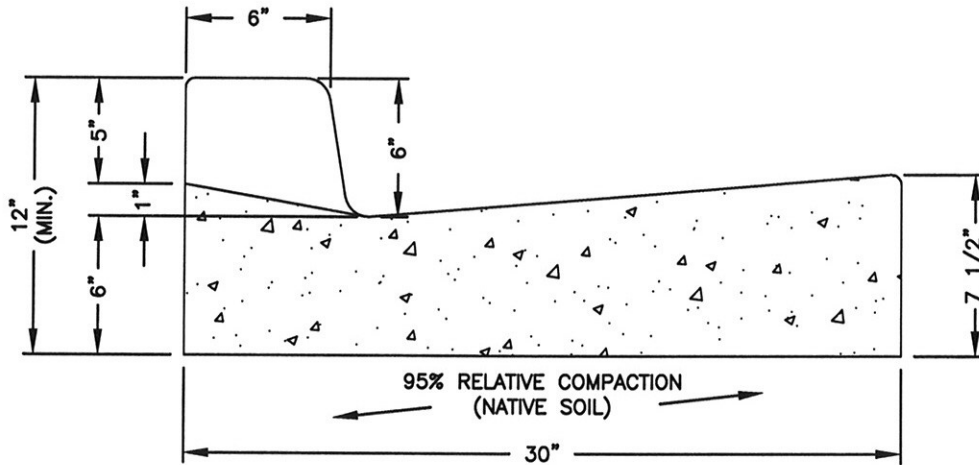

DEPRESSED CURB


NOTES:

1. FORMS TO REMAIN FOR A MIN. OF 24 HOURS.
2. WOOD FORMS SHALL HAVE A NORMAL THICKNESS OF 2", EXCEPT ON CURVE CONSTRUCTION WHERE THE THICKNESS SHALL BE DETERMINED BY THE CITY INSPECTOR.
3. MINIMUM GRADE FOR CURB & GUTTER SHALL NEVER BE LESS THAN .0015 SLOPE, EXCEPT CURVE PORTIONS OF CUL-DE-SAC STREETS WHICH SHALL HAVE .0020 SLOPE MINIMUM.
4. 1"x2" LINE & GRADE STAKES ARE TO BE SET 3' FROM FACE OF CURB. STAKE SPACING SHALL BE 25' MAX. FOR A SLOPE OF .0015 AND 50' MAX. FOR SLOPES OF .0020 OR MORE (OR EQUIVALENT CONTROLS).
5. SEE CONCRETE NOTES AND CITY STANDARD SPECIFICATIONS.
6. FILL AND GRADE AREA BEHIND CURB AS DIRECTED BY THE PUBLIC WORKS DIRECTOR.

CITY of CORCORAN • Department of Public Works

Standard Drawing for:

CURB AND GUTTER

APPROVED:  City Engineer

05/19/08
Date

Revised:

C-2