

# 2025 DRINKING WATER QUALITY REPORT



## Clean water made fresh daily.

Des Moines Water Works produces and delivers an average 54 million gallons of high-quality drinking water each day to 600,000 central Iowans through Central Iowa Water Works.

We are proud to share with you, our customer, that the water we produce at Des Moines Water Works **is safe and clean, meeting all state and federal requirements for drinking water.**



This document serves as Des Moines Water Works' report card. We make this report each year as a requirement of the Safe Drinking Water Act. Inside, you can read about raw water sources, detected contaminants and compliance requirements. You'll see a data table of EPA-required tests. Des Moines Water Works is compliant with all state and federal requirements. You can learn about the treatment process to better understand how we send clean water to your home or business every day.



Des Moines Water Works makes investments to ensure our water treatment experts have the equipment and technology they need so that when you turn on your tap, you are drinking safe, affordable drinking water that meets state and federal drinking water regulations.

**Raise a glass of high-quality, clean H<sub>2</sub>O with us!**

**Des Moines**  
**Water Works**  
Water You Can Trust for Life

**CIWW**  
CENTRAL IOWA WATER WORKS  
STRONGER TOGETHER

# WHERE DOES YOUR DRINKING WATER COME FROM?

The Raccoon and Des Moines Rivers are the natural resources used to make clean drinking water for 600,000 central Iowans. Upstream land use practices – agricultural and urban – have a direct effect on water quality and quantity for downstream users. All Iowans should **Think Downstream** and consider how they can help make Iowa's water safe for drinking and recreation.




Des Moines Water Works (DMWW) operates three water treatment plants for Central Iowa Water Works. Each treatment plant involves a multi-barrier approach to ensure the safety of your drinking water. This includes source water monitoring, riverbank filtration, treatment processes of softening, filtration and disinfection, as well as distribution system monitoring and maintenance.

The **L.D. McMullen Water Treatment Plant** at Maffitt Reservoir, located southwest of the metro area, treats up to 25 million gallons of water from six radial collector wells and one horizontal well along the Raccoon River, and serves customers in southwest Des Moines, Waukee and parts of Warren Water District, Clive, Urbandale and West Des Moines. The collection elements are located in the coarse sand and gravel formation beneath the river. The shallow groundwater receives natural filtration prior to entry into the wells.

**Saylorville Water Treatment Plant**, located in northern Polk County, serves water to residents north of Des Moines. This facility treats up to 10 million gallons of water from two radial collector wells along the Des Moines River and utilizes ultra-filtration and reverse osmosis to soften and treat the water.

All other areas in Des Moines Water Works' service area receive water from the **Fleur Drive Treatment Plant**. This plant treats up to 75 million gallons of water pumped from one of three sources: Raccoon River, Des Moines River and an Infiltration Gallery (a series of underground pipes located throughout Water Works Park adjacent to the Raccoon River).

## Treatment process at the Fleur Drive Treatment Plant

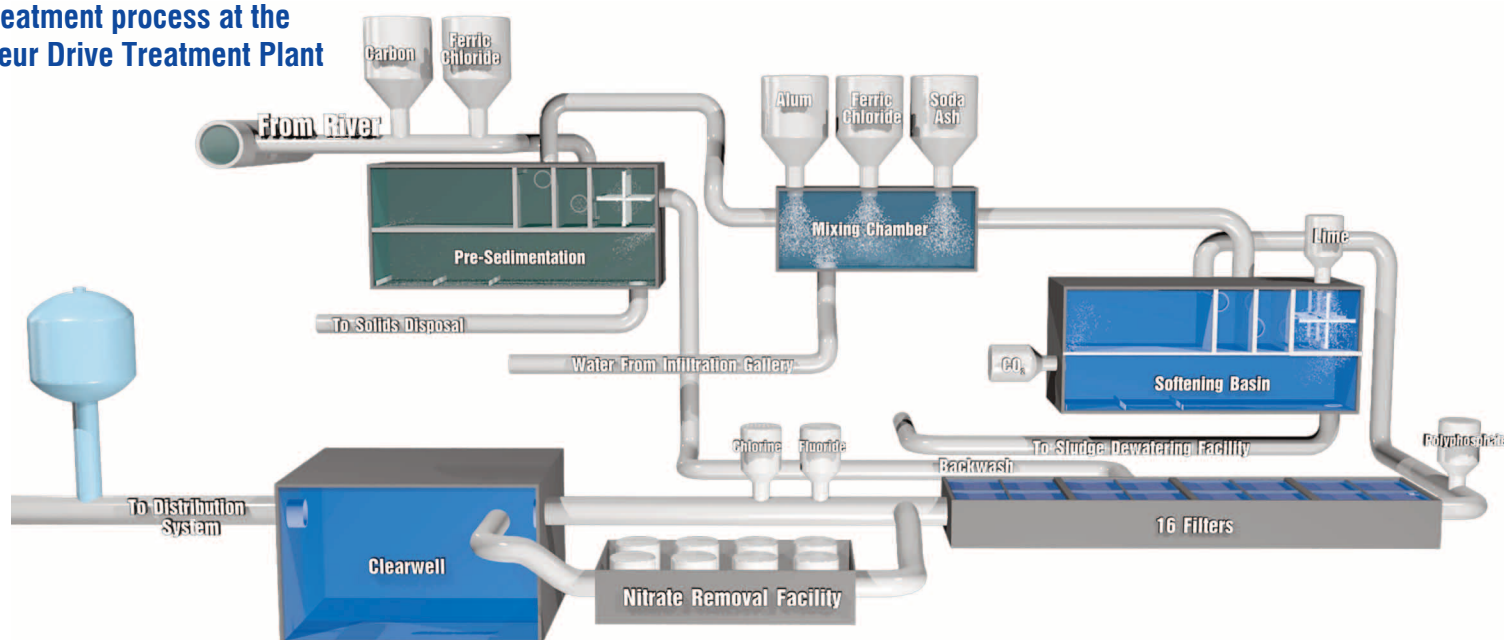

Once treated, 1,400 miles of underground pipe, 10,800 fire hydrants, 10,900 valves, 10 water storage tanks and 10 booster pumping stations distribute water to homes and businesses in Des Moines and surrounding communities.

## HOW WE SAFEGUARD YOUR WATER?

Throughout the treatment process, chemists and a microbiologist in Central Iowa Water Works' state-certified laboratory perform 100-150 tests each day to ensure the highest quality water is produced. An additional series of 50-60 daily tests on the untreated water sources allows laboratory staff to identify any necessary changes needed in the treatment process before the water enters the treatment plants.

DMWW monitors and tests for emerging and unregulated contaminants to stay ahead of potential health risks, including cyanotoxins produced by cyanobacteria, Per- and Poly-fluoroalkyl Substances (PFAS), neonicotinoids, and pharmaceutical and personal care products (PPCP).



The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring material and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or humans. Contaminants that may be present in raw source water include:



*Chemist Lisa Morarend analyzes water samples in Central Iowa Water Works' state-certified laboratory.*

**Inorganic Contaminants** such as salts and metals, which can occur naturally or come from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.

**Organic Chemicals** including synthetic and volatile organic chemicals, which are agriculture, industrial and petroleum process byproducts and can also come from gas stations, urban stormwater runoff and septic systems.

**Microorganisms** such as viruses and bacteria, which may come from agricultural livestock operations, sewage treatment plants, septic systems and wildlife.

**Pesticides and Herbicides** which may come from agriculture and urban stormwater runoff.

**Radioactive Contaminants** which can occur naturally or result from oil and gas production and mining activities.

## DEFINITIONS AND ABBREVIATIONS

**Action Level (AL)** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

**Coliform** Bacteria that are naturally present in the environment and are used as an indicator that other, potentially harmful, waterborne pathogens may be present or that a potential pathway exists through which contamination may enter the drinking water (RTCR).

**E.Coli** Bacteria whose presence indicates that the water may be contaminated with human or animal wastes.

**Level Found** The highest amount found in the water or the average of all samples analyzed, depending on the regulation. If multiple samples were tested in 2024, the lowest and highest detected values are listed under Range of Detections.

**LRAA** Locational running annual average.

**mg/L** Milligrams per liter, or parts per million (ppm). Parts of contaminant per million parts of water. One part per million is equivalent to a single penny in ten thousand dollars.

**MCL** The maximum contaminant level, the highest level of a substance allowed in drinking water.

**MCLG** The MCL Goal, the level of a substance where there is no known or expected health risk. MCLGs allow for a margin of safety. MCLs are set as close to MCLGs as feasible using the best available treatment processes.

**NA** Not applicable.

**ND** Not detected.

**ng/L** Nanograms per liter, or parts per trillion (ppt). Parts of contaminant per trillion parts of water. One part per trillion is equivalent to a single penny in ten billion dollars.

**NTU** Nephelometric turbidity units.

**pCi/L** Picocuries per liter, a measure of radioactivity.

**RTCR** Revised Total Coliform Rule

**TT** Treatment Technique. Certain treatment processes are required to reduce the level of turbidity in the drinking water. Turbidity must not ever exceed 1 NTU, and must be less than 0.3 NTU 95% of the time.

**Turbidity** Turbidity is a measure of cloudiness of the water. It is monitored because it is a good indicator of the effectiveness of the filtration system.

**µg/L** Micrograms per liter, or parts per billion (ppb). Parts of contaminant per billion parts of water. One part per billion is equivalent to a single penny in ten million dollars.

2024 WATER QUALITY RESULTS

Water Treatment Plant Monitoring

Before water can be delivered to your home, it must first be analyzed by certified laboratories at Central Iowa Water Works/Des Moines Water Works' Fleur Drive Treatment Plant and the State Hygienic Laboratory. Results for 2024 in this report include samples taken as water leaves the three treatment plants that Des Moines Water Works manages and from samples obtained from the various water distribution systems supplied with water by Des Moines Water Works.

2024 LAB RESULTS				Fleur Drive Treatment Plant			L.D. McMullen Water Treatment Plant			Saylorville Water Treatment Plant			COMMON SOURCES OF CONTAMINANT
	UNITS	MCL	MCLG	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	
WATER CLARITY													
Turbidity	NTU	TT	N/A	2024	0.29	0.00-0.29	2024	0.39	0.02-0.39	2024	0.09	0.02-0.09	Soil runoff
ORGANIC CONTAMINANTS													
Atrazine	µg/L	3	3	2022	0.2	N/A	2022	ND	N/A	2023	ND	N/A	Agriculture activity
Cis-1,2 Dichloroethylene	µg/L	70	70	2024	0.5	N/A	2022	ND	N/A	2023	ND	N/A	Discharge from industrial chemical factories
Metolachlor	µg/L	N/A	N/A	2022	0.2	N/A	2022	ND	N/A	2023	ND	N/A	Agriculture activity
Dalapon	µg/L	200	200	2022	ND	N/A	2022	0.2	N/A	2023	ND	N/A	Herbicide usage
INORGANIC CONTAMINANTS													
Fluoride	mg/L	4	4	2024	0.85	0.17-0.85	2024	0.91	0.15-0.91	2024	0.81	ND-0.81	Additive for strong teeth; erosion of natural deposits; discharge from fertilizer factories Agriculture activity; leaching from septic tanks; sewage; erosion of natural deposits Erosion of natural deposits
Nitrate [as N]	mg/L	10	10	2024	8.97	0.17-8.97	2024	8.60	0.14-8.60	2024	4.40	ND-4.40	
Sodium	mg/L	N/A	N/A	2024	75.77	11.27-75.77	2024	69.54	12.30-69.54	2024	24.30	11.06-24.30	
Barium	mg/L	2	2	2021	ND	N/A	2021	ND	N/A	2020	0.07	N/A	Metal refinery and drilling waste discharge; erosion of natural deposits
				YEAR TESTED	ANNUAL REMOVAL RATIO	MINIMUM REMOVAL REQUIREMENT	YEAR TESTED	ANNUAL REMOVAL RATIO	MINIMUM REMOVAL REQUIREMENT	YEAR TESTED	ANNUAL REMOVAL RATIO	MINIMUM REMOVAL REQUIREMENT	
TREATMENT PLANT													
Total Organic Carbon	mg/L	TT	N/A	2024	3.27	1	2024	2.77	1	2024	3.53	1	Naturally present in the environment

**DES MOINES WATER WORKS** operates three Aquifer Storage and Recovery (ASR) wells, the **CITY OF ANKENY** operates two ASR wells and the **CITY OF WAUKEE** operates one ASR well. Treated drinking water is injected into wells during low demand cold weather months, and recovered for use during high demand warm-weather months to help limit the use of poor quality source water and meet customer demand. Testing data unique to this water can be seen on the chart below.

2024 ASR LAB RESULTS				Louise P. Moon ASR Well			L.D. McMullen ASR Well			Army Post Road ASR Well			Ankeny ASR Well 4			Ankeny ASR Well 6		
	UNITS	MCL	MCLG	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS
PARAMETER																		
Alpha Emitters	pCi/L	15	0	2024	3.6	N/A	2024	5.2	N/A	2024	6.5	N/A	2023	8.0	N/A	2024	9.3	N/A
Arsenic	µg/L	10	0	2024	1	ND-1	2024	ND	N/A	2024	2	ND-2	2024	1	ND-1	2024	2	ND-2
Combined Radium	pCi/L	5	0	2024	1.1	N/A	2024	ND	N/A	2024	1.5	N/A	2024	1.6	1.6	2024	1.1	N/A
Fluoride	mg/L	4	4	2024	1.4	0.8-1.4	2024	0.9	0.6-0.9	2024	1.5	0.7-1.5	2023-24	1.2	0.8-1.2	2023-24	1.2	0.8-1.2
Nitrate [as N]	mg/L	10	10	2024	4.7	0.2-4.7	2024	8.6	0.5-8.6	2024	5.1	0.7-5.1	2024	1.0	ND-1.0	2023-24	1.5	ND-1.5
Sodium	mg/L	N/A	N/A	2024	78	25-78	2024	32	12-32	2024	86	24-86	2023-24	54	23-54	2023-24	45	24-45
Radon	pCi/L	N/A	N/A	2024	70	N/A	2024	58	N/A	2024	85	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Waukee ASR Well 2																		
	UNITS	MCL	MCLG	YEAR TESTED	LEVEL FOUND	RANGE OF DETECTIONS												
PARAMETER							PARAMETER			COMMON SOURCES OF CONTAMINANT			PARAMETER			COMMON SOURCES OF CONTAMINANT		
Alpha Emitters	pCi/L	15	0	2024	4.4	3.8-4.4	Alpha Emitters			Erosion of natural deposits			Nitrate [as N]			Agriculture activity; leaching from septic tanks; sewage; erosion of natural deposits		
Arsenic	µg/L	10	0	2024	1	N/A	Arsenic			Erosion of natural deposits								
Combined Radium	pCi/L	5	0	2024	2.9	ND-2.9	Atrazine			Agriculture activity								
Fluoride	mg/L	4	4	2024	1.6	1.0-1.6	Combined Radium			Erosion of natural deposits			Radon			Breakdown of uranium in the ground		
Nitrate [as N]	mg/L	10	10	2024	2.0	0.5-2.0	Fluoride			Additive for strong teeth; erosion of natural deposits; discharge from fertilizer factories			Sodium			Erosion of natural deposits		
Sodium	mg/L	N/A	N/A	2024	95	39-95												

Water Distribution System Monitoring

Water is regularly monitored throughout the distribution systems served by Des Moines Water Works for disinfectant, disinfection byproducts, bacteria, lead and copper. The table below shows the results of this monitoring.

2024 DISTRIBUTION RESULTS	Total Trihalomethanes (TTHM) (µg/L)		Haloacetic Acids (HAA5) (µg/L)		Lead (µg/L)			Copper (mg/L)			Coliform Bacteria (positive)		Chlorine Disinfectant (mg/L)	
	Byproducts of chlorination MCL: 80 µg/L MCLG: no limit set		Byproducts of chlorination MCL: 60 µg/L MCLG: no limit set		From plumbing corrosion 90% of all samples must be below Action Level of 15 µg/L			From plumbing corrosion 90% of all samples must be below Action Level of 1.3 mg/L			Naturally present in the environment Treatment Technique (TT)		Added to prevent bacterial growth Maximum limit for annual average: 4 mg/L	
SYSTEM	Level Found	Range of Detections	Level Found	Range of Detections	Year Tested	90% of test levels were less than	Range of Detections	Year Tested	90% of test levels were less than	Range of Detections	Monthly Samples	Positive Samples	Running Annual Average	Range
Des Moines*	67	54-77	14	11-15	2024	ND	ND-21 <sup>1</sup>	2024	ND	ND-0.072	151	6 <sup>2</sup>	1.20	0.18-2.19
Ankeny	57	41-73	10	9-11	2022	ND	ND	2022	ND	ND-0.028	70	0	0.90	0.12-1.70
Bondurant	53	46-61	25	16-40	2024	1.3	ND-9	2024	0.008	ND-0.011	8	0	2.20	1.03-2.77
Clive	63	51-71	12	8-17	2022	ND	ND	2022	ND	ND-0.032	20	0	1.00	0.33-1.82
East Dallas Water	40	31-47	9	7-13	2024	ND	ND	2024	ND	ND	1	0	2.50	2.20-2.90
Earlham	32	N/A	9	N/A	2023	2.0	ND-2	2023	0.010	ND-0.010	2	0	1.90	1.65-2.36
Johnston	55	24-76	25	16-45	2022	ND	ND-5	2022	0.117	0.006-0.177	25	0	0.80	0.15-1.58
New Virginia	57	50-70	13	10-15	2022	ND	ND	2022	ND	ND	1	0	2.00	1.70-2.20
Norwalk	79	62-102	13	7-18	2022	ND	ND	2022	ND	ND-0.050	10	1 <sup>2</sup>	1.00	0.40-1.45
SE Polk Rural Water**	79	66-96	13	9-17	2024	ND	ND-28 <sup>1</sup>	2024	ND	ND-0.027	9	0	0.90	0.19-2.02
Urbandale	77	59-99	12	9-16	2024	ND	ND-44 <sup>1</sup>	2024	ND	ND	50	1 <sup>2</sup>	1.00	0.36-1.69
Warren Water District	58	47-75	12	10-16	2023	ND	ND-7	2023	0.022	ND-0.046	20	0	2.40	2.00-3.00
Waukee	67	50-92	12	9-16	2024	ND	ND	2024	0.077	ND-0.109	25	1 <sup>2</sup>	1.00	0.33-1.72

\* Includes water supplied to Alleman, Berwick, Cumming, Pleasant Hill, Unincorporated Polk County and Windsor Heights. \*\* Includes water supplied to Runnells and eastern portions of Pleasant Hill. <sup>1</sup> One sample over the Action Level (AL) of 15 µg/L. <sup>2</sup> Sample tested positive for coliform bacteria. Repeat samples indicated bacteria were not present, and the water was determined to be safe to consume.

Unregulated Contaminants

The U.S. Environmental Protection Agency required some water systems and cities to take samples in 2023 and 2024 for an assessment monitoring program for the Unregulated Contaminant Monitoring Rule 5 (UCMR5). The EPA will review the findings of this nationwide assessment to determine if any new regulations are needed.

Lithium (µg/L)					
SYSTEM	Year Tested	Range	SYSTEM	Year Tested	Range
Des Moines	2023	ND-28	Urbandale	2023-24	27-28
Ankeny	2024	16-28	SE Polk Rural Water	2024	4-14
Clive	2023-24	26-43	Warren Water District	2023-24	26-30
Norwalk	2023	4-48	Waukee	2024	25-61

PFHxS (Perfluorohexanesulfonic acid) (ng/L)		
SYSTEM	Year Tested	Level Found
Des Moines	2024	2.3



# DRINKING WATER AND HEALTH INFORMATION

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care providers about drinking water. Information about contaminants and potential health effects can be obtained by contacting the **Safe Drinking Water Hotline**.

## EPA Safe Drinking Water Hotline

(800) 426-4791 or <http://water.epa.gov/drink>

### NITRATE

Nitrate in drinking water at levels above 10 parts per million (ppm) is a health risk for infants less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. If you are caring for an infant, you should ask for advice from your healthcare provider. Nitrate levels may rise quickly for short periods of time because of groundwater conditions and agricultural activity. Des Moines Water Works uses a variety of strategies to keep the treated tap water below 10 ppm. These strategies include source water blending, and if necessary, removal of nitrate using a treatment process known as ion exchange. Despite frequently elevated nitrate levels in the Raccoon and Des Moines Rivers, Des Moines Water Works' treated water has not exceeded the 10 ppm standard since nitrate removal was implemented in 1992.

### LEAD

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Des Moines Water Works minimizes the potential for exposure to lead in drinking water by following a corrosion control program approved by the Iowa Department of Natural Resources. Lead can get into drinking water from materials and components associated with private service lines and home plumbing. When your water has been sitting for several hours, you can further minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure are available from the Safe Drinking Water Hotline.

### LITHIUM

Naturally occurring metal that may concentrate in brine waters; lithium salts are used as pharmaceuticals, used in electrochemical cells, batteries, and in organic syntheses.

### PFAS

PFAS are a group of synthetic chemicals used in a wide range of consumer products and industrial applications including: non-stick cookware, water-repellent clothing, stain-resistant fabrics and carpets, cosmetics, firefighting foams, electroplating, and products that resist grease, water and oil. PFAS are found in the blood of people and animals and in water, air, fish, and soil at locations across the United States and the world.

### RADON

Radon is a naturally-occurring gas present in some groundwater. Inhaled radon has been linked to lung cancer and may pose a health risk when inhaled after the release from water into the air. This inhalation could occur during showering, bathing, washing dishes, or washing clothes. The radon gas release from drinking water is a relatively small part of the total radon found in air. One major source of radon gas is from the soil, where the gas can seep through the foundations of homes. It is not clear whether ingested (i.e. taken through the mouth) radon contributes to cancer or other adverse health conditions. If you are concerned about radon in your home, tests are available to determine the total exposure level. For additional information on home testing contact Polk County Health Department: (515) 286-3798.

## SOURCE WATER ASSESSMENT

Des Moines Water Works obtains water from one or more surface waters. Surface water sources are susceptible to sources of contamination or pollution within the Raccoon and Des Moines River watersheds.

Surface Water Name	Susceptibility
Crystal Lake	High
Des Moines River	High
Maffitt Reservoir	High
Raccoon River	High

Water is also obtained from aquifers. The Alluvial Aquifer was determined to be highly susceptible to contaminations because the characteristics of the aquifer and overlying materials provide little protection from contamination at the land surface. The Alluvial wells will be highly susceptible to surface contamination such as leaking underground storage tanks, contaminant spills, and excess fertilizer application.

The Cambrian-Ordovician Aquifer was determined to have low susceptibility to contamination because the characteristics of the aquifer and overlying materials provide natural protection from contaminants at the land surface.

To obtain a copy of the Source Water Assessment, call (515) 283-8700 to request a printed copy.



*Sampling technician Bill Blubaugh takes samples from the Des Moines River.*

# PUBLIC MEETING AND UTILITY CONTACT INFORMATION

Some public meetings have been moved to virtual or hybrid formats. Check with the city/entity for the most up to date information.

## CITY OF ALLEMAN

### Public Meeting:

2<sup>nd</sup> Monday of the month at 7:00 pm  
Alleman City Hall  
14000 NE 6<sup>th</sup> Street · Alleman, IA 50007

### Contact Information:

Des Moines Water Works  
(515) 283-8700 · customerservice@dmww.com

## CITY OF ANKENY

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Monday of each month at 5:30 pm  
Kirkendall Library  
1250 SW District Drive · Ankeny, IA 50023

### Contact Information:

Customer Service  
220 West 1<sup>st</sup> Street · Ankeny, IA 50023  
(515) 963-3565 · customerservice@ankenyiowa.gov

## BERWICK WATER ASSOCIATION

### Public Meeting:

Annual meeting and as needed  
5825 NE Berwick Drive · Berwick, IA 50032

### Contact Information:

Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com

## CITY OF BONDURANT

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Monday of each month at 6:00 pm  
Bondurant City Hall  
200 2<sup>nd</sup> Street NE · Bondurant, IA 50035

### Contact Information:

Patrick F. Collison  
(515) 971-6856 · pcollison@cityofbondurant.com

## CITY OF CLIVE

### Public Meeting:

2<sup>nd</sup> & 4<sup>th</sup> Thursday of each month at 6:00 pm  
Clive City Hall  
1900 NW 114<sup>th</sup> Street · Clive, IA 50325

### Contact Information:

Jeff May, Public Works Director  
2123 NW 111<sup>th</sup> Street · Clive, IA 50325  
(515) 223-6231 · jmay@cityofclive.com

## CITY OF CUMMING

### Public Meeting:

2<sup>nd</sup> & 4<sup>th</sup> Monday each month at 7:00 pm  
Cumming City Hall  
649 N 43<sup>rd</sup> Street · Cumming, IA 50061

### Contact Information:

Cumming City Hall  
(515) 981-9214  
Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com

## DES MOINES WATER WORKS

### Public Meeting:

4<sup>th</sup> Tuesday of each month at 3:30 pm  
Des Moines Water Works  
2201 George Flagg Parkway · Des Moines, IA 50321

### Contact Information:

Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com

## CITY OF EARLHAM

### Public Meeting:

2<sup>nd</sup> Monday of each month at 7:00 pm  
Earlham City Hall  
140 South Chestnut Avenue · Earlham, IA 50072

### Contact Information:

Gary Coffman, Public Works Supervisor  
(515) 758-2281 · earlhamcityhall@mchsi.com

## CITY OF JOHNSTON

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Monday of each month at 7:00 pm  
Johnston City Hall  
6221 Merle Hay Road · Johnston, IA 50131

### Contact Information:

Shane Kinsey  
6400 NW Beaver Drive · Johnston, IA 50131  
(515) 278-0822 · skinsey@cityofjohnston.com

## NEW VIRGINIA WATER WORKS

### Public Meeting:

1<sup>st</sup> Monday of each month at 7 pm  
Fire Station meeting room  
506 West Street · New Virginia, IA 50210

### Contact Information:

Jennifer Baughman, City Clerk  
(641) 449-3492 · cityclerk@newvirginia.com

## CITY OF NORWALK

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Thursday of each month at 6:00 pm  
Norwalk City Hall  
705 North Avenue · Norwalk, IA 50211

### Contact Information:

Wayne Schwartz, P.E., Public Works Director  
(515) 981-9527 · wschwartz@norwalk.iowa.gov

## CITY OF PLEASANT HILL

### Public Meeting:

2<sup>nd</sup> & 4<sup>th</sup> Tuesday of each month at 6:00 pm  
Pleasant Hill City Hall  
5160 Maple Drive, Suite A · Pleasant Hill, IA 50317

### Contact Information:

Pleasant Hill Public Works  
(515) 262-9465  
Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com

## CITY OF RUNNELLS

### Public Meeting:

2<sup>nd</sup> Tuesday of each month at 7:00 pm  
Community Center  
108 Brown Street · Runnells, IA 50237

### Contact Information:

Runnells City Hall  
(515) 966-2042  
Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com

## URBANDALE WATER UTILITY

### Public Meeting:

Meets monthly · Call 278-3940 for information  
Urbandale Water Utility  
3720 86<sup>th</sup> Street · Urbandale, IA 50322

### Contact Information:

Neil Weiss, General Manager  
(515) 278-3940 · nweiss@urbandalewater.org

## WARREN WATER DISTRICT

### Public Meeting:

3<sup>rd</sup> Monday of each month at 6:00 pm  
Warren Water District  
1204 East 2<sup>nd</sup> Avenue · Indianola, IA 50125

### Contact Information:

Matt Van Wyk, System Manager  
(515) 962-1200 · wwd@warrenwaterdistrict.com

## CITY OF WAUKEE

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Monday each month at 5:30 pm  
Waukee City Hall  
230 W. Hickman Road · Waukee, IA 50263

### Contact Information:

Rudy Koester, Public Works Director/City Engineer  
(515) 978-7920 · rkoester@waukee.org  
Waukee Utility Customer Service  
(515) 978-5502

## CITY OF WINDSOR HEIGHTS

### Public Meeting:

1<sup>st</sup> & 3<sup>rd</sup> Monday each month at 6:00 pm  
Windsor Heights City Hall  
1133 66<sup>th</sup> Street · Windsor Heights, IA 50324

### Contact Information:

Windsor Heights City Hall  
(515) 279-3662  
Des Moines Water Works Customer Service  
(515) 283-8700 · customerservice@dmww.com