




CULINARY
WATER



SECONDARY
WATER

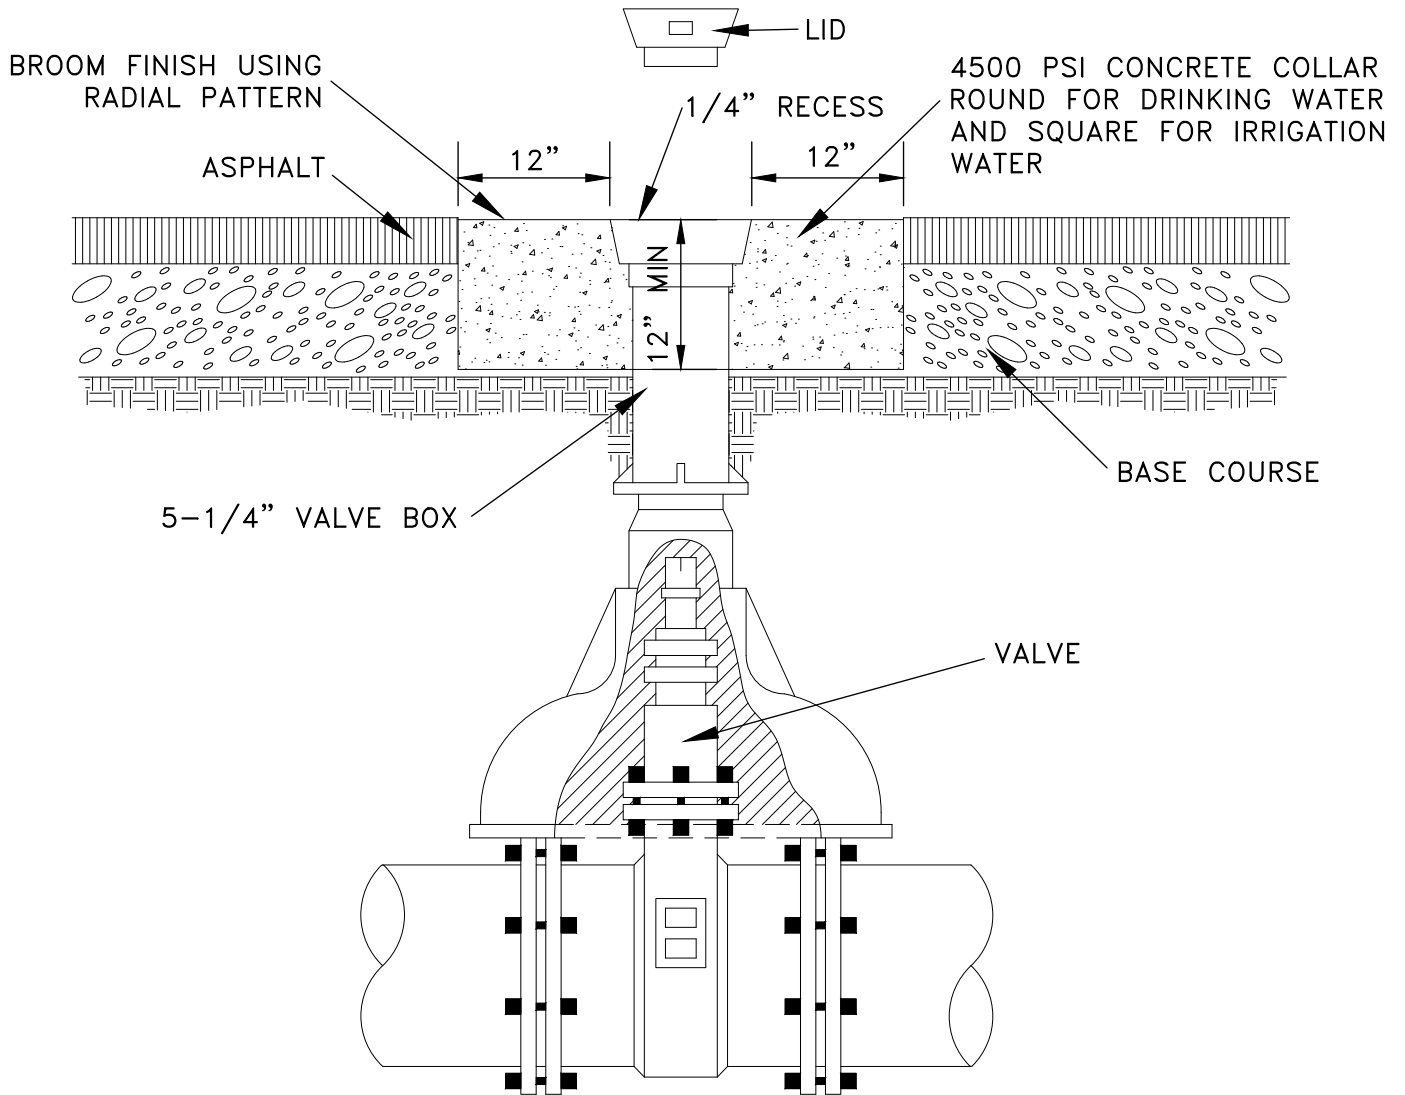

NOTES:

1. RAISE VALVE BOX AND PLACE CONCRETE COLLAR AFTER PAVING OPERATION IS COMPLETED.
2. ALL PIPES, FITTINGS & APPURTENANCES SHALL BE NSF-61 CERTIFIED.
3. BURIED GATE VALVES SHALL BE USED FOR LINES 10-INCHES AND SMALLER. BURIED BUTTERFLY VALVES SHALL BE USED FOR LINES 12-INCHES AND LARGER.
4. ISOLATION VALVES SHALL BE PROVIDED AT NO MORE THAN 500-FOOT INTERVALS IN COMMERCIAL DISTRICTS AND AT NOT MORE THAN ONE BLOCK OR 800-FOOT INTERVALS IN OTHER DISTRICTS, [UAC 309-550-5(8)].

REV. 01-22

GRANTSVILLE CITY VALVE BOX COLLAR DETAIL