


BACKFLOW PREVENTER POSITIVE PRESSURE
AS APPROVED BY ENGINEER

PROVIDE A HEATED
SECURITY ENCLOSURE,
SUBJECT TO CITY
ENGINEER APPROVAL.
DRAIN TO DAYLIGHT
REQUIRED.

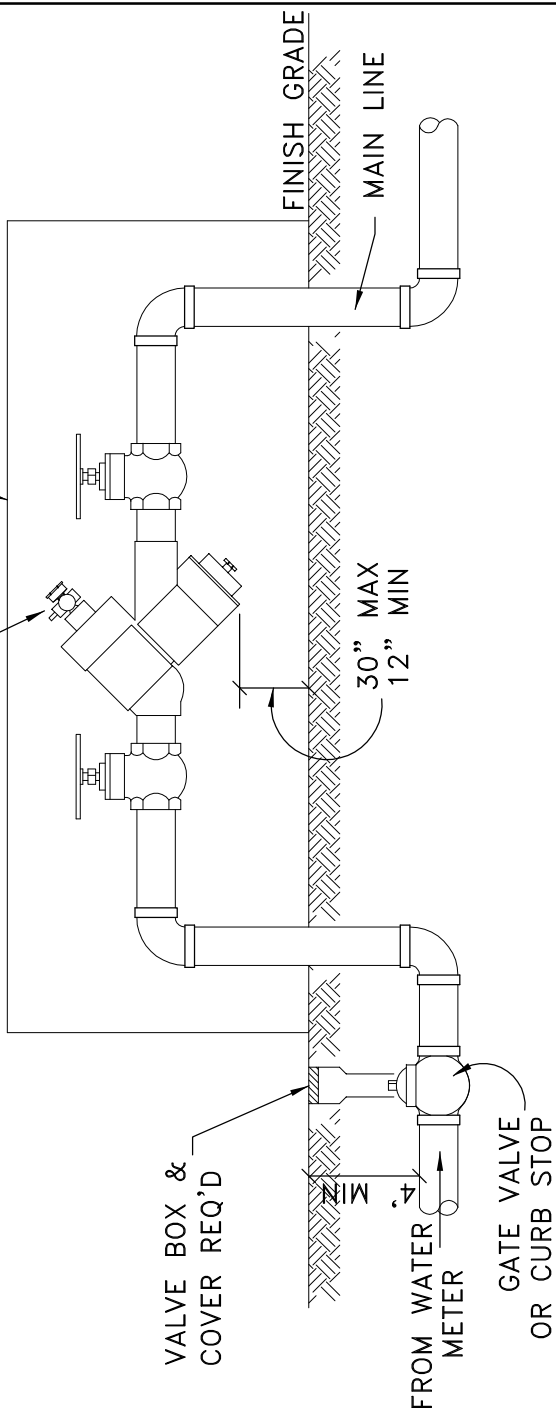

NOTES:

1. ALL PIPES, FITTING & APPURTENANCES SHALL BE NSF-61 CERTIFIED.
2. ALL NEW OR REPLACED WATER LINES SHALL BE FLUSHED & DISINFECTED PER AWWA STANDARD C651 LATEST EDITION.

GRANTSVILLE CITY
TYPICAL BACKFLOW PREVENTER INSTALLATION